


*Seven Heater Installation

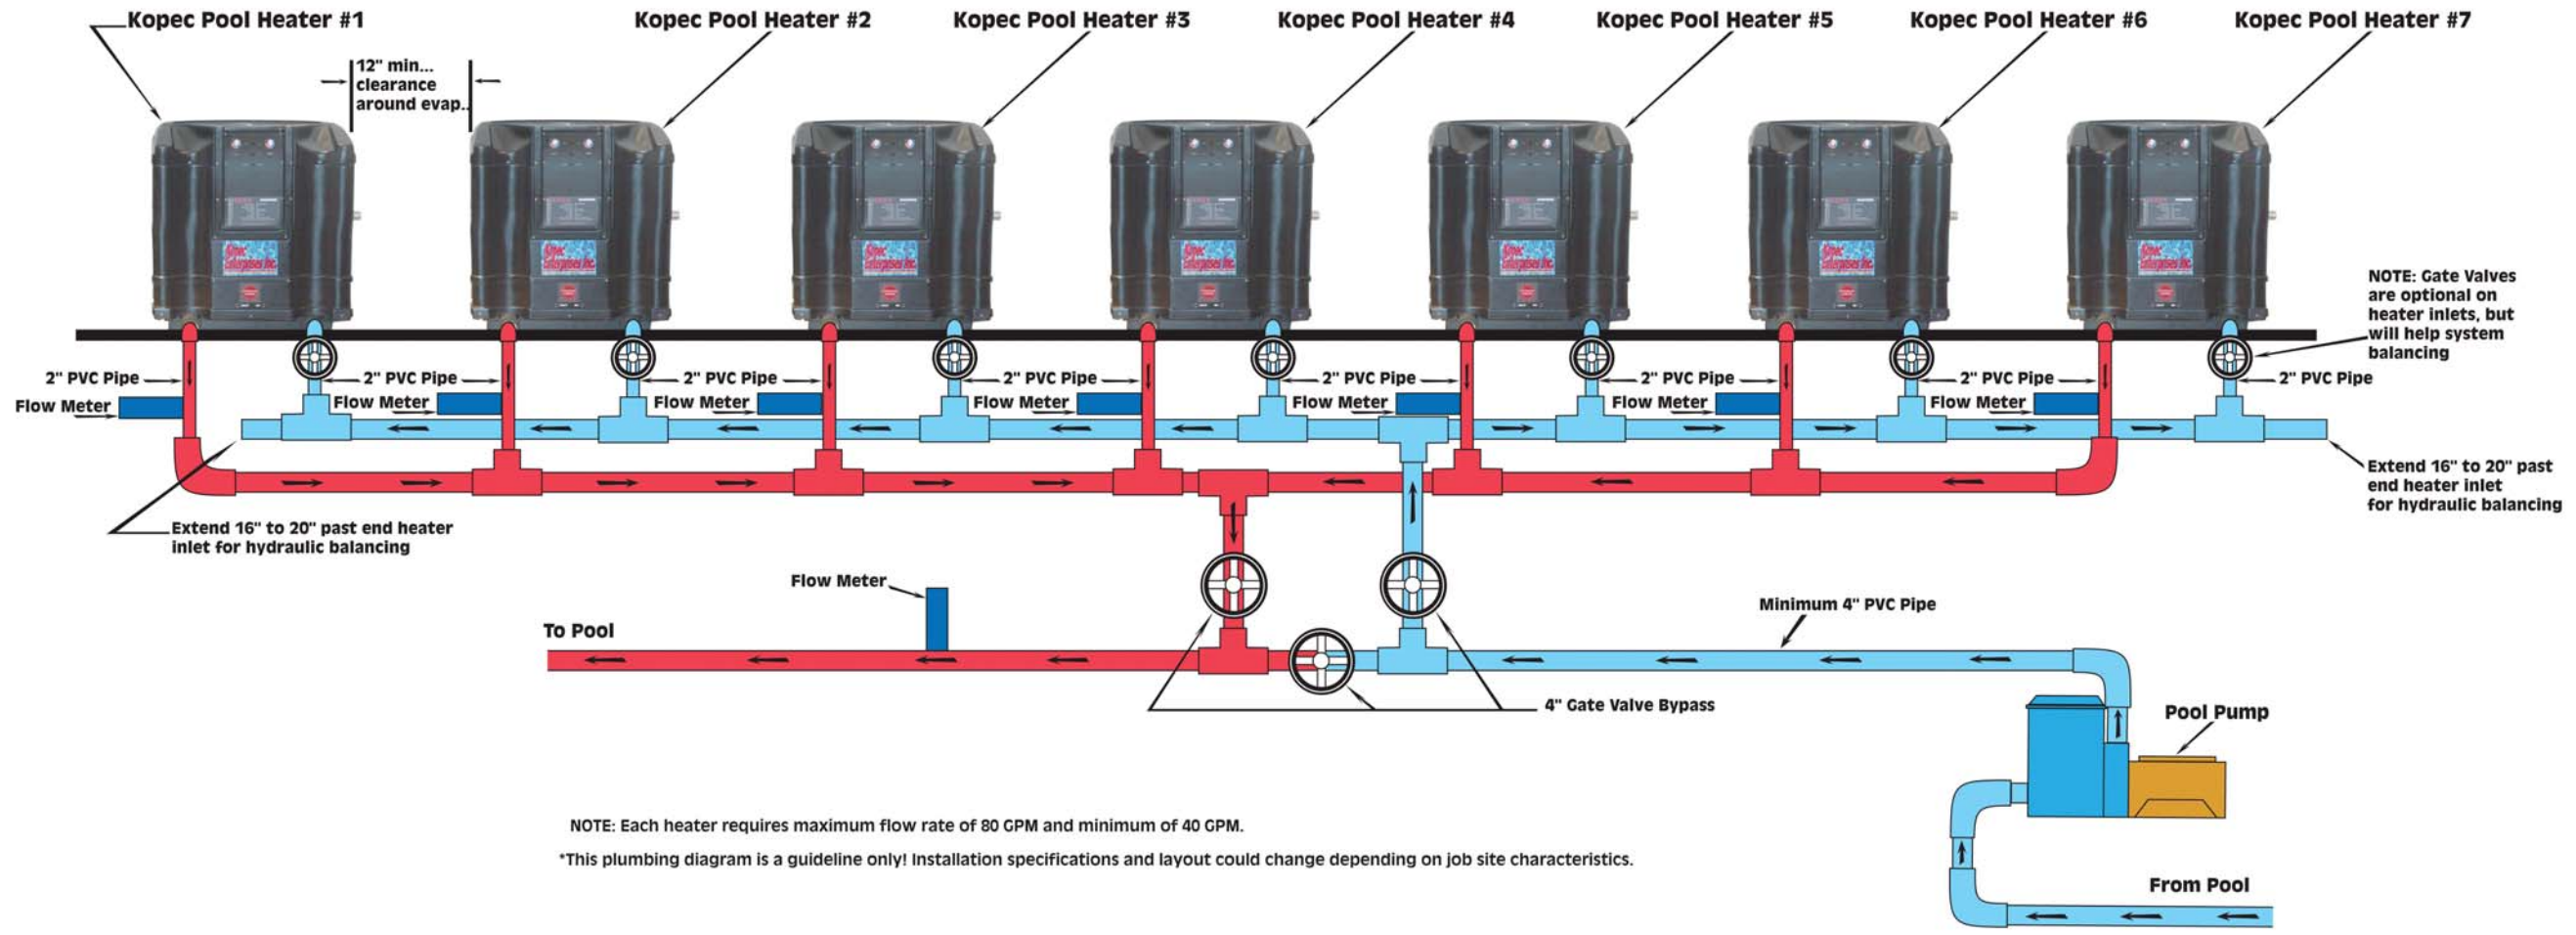

NOTE: Each heater requires maximum flow rate of 80 GPM and minimum of 40 GPM.
 *This plumbing diagram is a guideline only! Installation specifications and layout could change depending on job site characteristics.